FUTERA II INSTALLATION AND OPERATION INSTRUCTIONS

Angle Valve

Bufferfly Valve

Solenoid

Operated Valve

Pressure ducing Valve

Check Valve

太

Pressure Relief Valve

181

Aguastat Union


Pressure Switch


Gas Pressure Regulator

> Backflow-Prevention Device

Figure 14A - Low Temperature Boiler Piping

(See Notes and Adjustment Procedures)

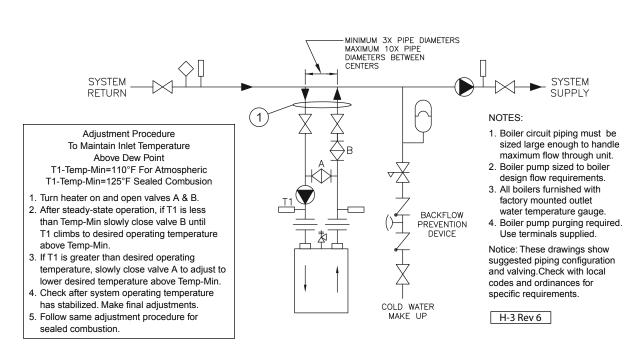

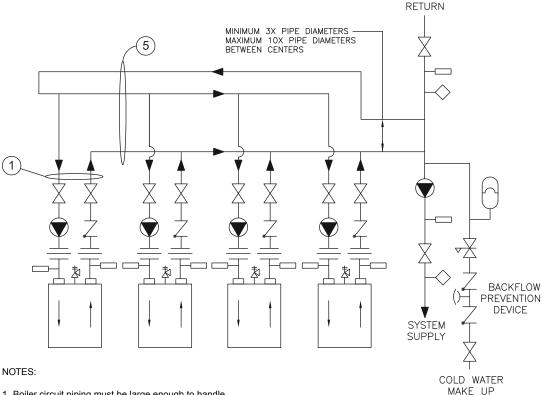

H-15 Rev 5

SYSTEM

- Boiler circuit piping must be large enough to handle maximum flow through unit.
- 2. Boiler pump sized to boiler design flow requirements.
- All boilers furnished with factory mounted outlet water temperature gauge.
- 4. Boiler pump purging required. Use terminals supplied.
- Secondary loop pipe diameter must be sized large enough to handle maximum flow through all units.

Notice: These drawings show suggested piping configuration and valving. Check with local codes and ordinances for specific requirements.