


SUBMITTAL

| | | |
|-------------------------|----------------------|---------------------------|
| JOB: | ORDER NO: | DATE: |
| | SUBMITTED BY: | DATE: |
| UNIT TAG: | APPROVED BY: | DATE: |
| CITY: | ENGINEER: | BUILDING TYPE: |
| | | |
| STATE: | CONTRACTOR: | CONSTRUCTION TYPE: |
| | | |
| COMPLETION DATE: | | |

DESCRIPTION

CircuitSolver[®] is a self-acting thermostatic recirculation valve which automatically and continuously maintains the end of each domestic hot water supply line at the specified water temperature. Since the CircuitSolver[®] responds to water temperature and controls flow to the return, it eliminates the need to manually balance the system.

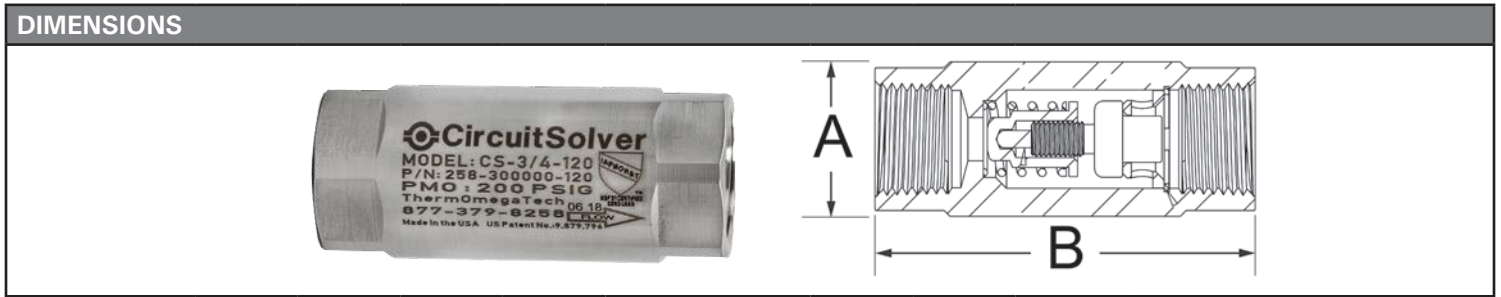

| | | Diameter (A) | | Length (B) | | Weight | | C _v | | Max. Pressure | | Max. Temp. | |
|---------------|--------|--------------|----|------------|-----|--------|-----|----------------|--------|---------------|-----|------------|-----|
| Model No. | NPT | IN | MM | IN | MM | LBS. | KG | OPEN | CLOSED | PSIG | BAR | °F | °C |
| CS- 1/2 -XXX | 1/2" | 1.1 | 29 | 2.8 | 70 | 0.5 | 0.2 | 1.3 | 0.1 | 200 | 14 | 300 | 149 |
| CS- 3/4 -XXX | 3/4" | 1.4 | 35 | 3.1 | 80 | 0.8 | 0.4 | 1.8 | 0.1 | | | | |
| CS-1-XXX | 1" | 1.8 | 44 | 3.4 | 86 | 1.6 | 0.7 | 3.3 | 0.15 | | | | |
| CS-1 1/4 -XXX | 1 1/4" | 2.1 | 54 | 4.6 | 117 | 2.8 | 1.3 | 5.1 | 0.15 | | | | |
| CS-1 1/2 -XXX | 1 1/2" | 2.4 | 60 | 4.6 | 117 | 3.5 | 1.6 | 7.6 | 0.15 | | | | |
| CS-2-XXX | 2" | 3.0 | 76 | 4.9 | 124 | 5.6 | 2.5 | 14.2 | 0.15 | | | | |


Model Number Selection

XXX refers to the desired closing temperature. When the water temperature drops below this point the CircuitSolver[®] will begin to open, allowing water to easily enter the return line. For example, if you want 120°F desired return temperature and the CircuitSolver[®] is to be installed on a 3/4" line, the model number would be CS-3/4-120.

FLOW RATE CALCULATION USING "CV" FACTOR SHOWN IN TABLE ABOVE (FOR WATER G = 1.0)

$$GPM = C_v \sqrt{\frac{\Delta P}{G}} \quad C_v = \sqrt{\frac{GPM}{\Delta P}} \quad \Delta P = \left[\frac{GPM}{C_v} \right]^2 G$$

MATERIALS

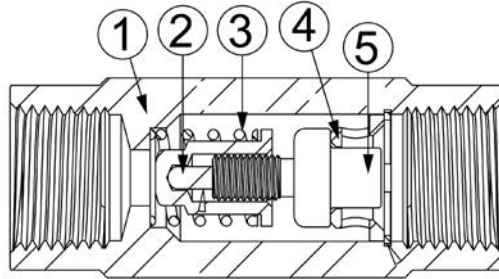

| ITEM | DESCRIPTION | MATERIAL |
|------|------------------|---------------------|
| 1 | Valve Body | 303 stainless steel |
| 2 | Valve Plug | 303 stainless steel |
| 3 | Spring | 302 stainless steel |
| 4 | Carrier | 303 stainless steel |
| 5 | Thermal Actuator | 303 stainless steel |

TYPICAL SPECIFICATION

- I. Furnish and install CIRCUITSOLVER® as indicated on the plans. CIRCUITSOLVER® shall be self contained and fully automatic without additional piping or control mechanisms. Valve shall be a CIRCUITSOLVER® as manufactured by ThermOmegaTech®, Inc., or equivalent.
 - A. CIRCUITSOLVER® shall regulate the flow of recirculated domestic hot water based on water temperature entering the CIRCUITSOLVER® regardless of system operating pressure.
 1. Even when fully closed the CIRCUITSOLVER® shall bypass a small amount hot water to maintain dynamic control of the recirculating loop.
 2. CIRCUITSOLVER® shall be factory adjustable as required by project conditions.
 3. CIRCUITSOLVER® shall be available in sizes ranging from ½" NPT to 2" NPT.
- II. CIRCUITSOLVER® body and all internal components shall be constructed of stainless steel with major components constructed of type 303 stainless steel.
 - A. CIRCUITSOLVER® sizes ½" through 2" shall be rated to 200 PSIG maximum working pressure.
 1. All CIRCUITSOLVER® shall be standard tapered female pipe thread, NPT.
 - B. All CIRCUITSOLVER® shall be rated to 300°F (148.9°C) maximum working temperature.
 - C. All CIRCUITSOLVER® shall be NSF-61 certified for use in all domestic water systems.
 - D. Thermal actuator shall be spring loaded and self cleaning, delivering closing thrust sufficient to keep orifice opening free of scale deposits.
- III. Installation of CIRCUITSOLVER® shall be made by qualified tradesmen. Install CIRCUITSOLVER® in each domestic hot water return piping branch beyond last hot water device in that branch.
 - A. Provide suitable line size isolation valves, unions, and strainer as indicated in piping detail shown on the drawings.
 - B. Provide suitable access panel as required in non-accessible ceilings and walls.